

PROVIDING COMPLETE FIRE FIGHTING SOLUTION



**G-FORCE**<sup>TM</sup>  
FIRE SERVICES




FIRE EXTINGUISHER



HOSE REEL DRUM



FIRE MODULER

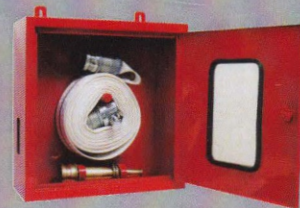

HOSE BOX



**MSME**  
सूक्ष्म, लघु एवं मध्यम उद्योग  
MICRO, SMALL & ENTERPRISES



ISO 9001 : 2015

**G-FORCE FIRE SERVICES**  
Approved by Government of Maharashtra Licence Agency

Mob.: 9821886364 / 7506722506

E-mail : [mumbaiqforce@gmail.com](mailto:mumbaiqforce@gmail.com) • Website : [www.aforcefire.in](http://www.aforcefire.in)



## Dry Chemical Powder A.B.C. Type Fire Extinguisher (Stored pressure type)

Suitable for Class 'A', 'B' and 'C' Fires involving Wood, Paper, Burning Liquids, Oil Petrol, Paints Electricity and Gases Etc.



PERFORMANCE DATA					
MODEL	1	2	4	6	9
Capacity	1 Kg	2 Kg	4 Kg	6 Kg	9 Kg
Fire Rating	1A:8B	1A:13B	2A:21B	2A:34B	3A:55B
Average discharge time	9.0 sec	14.0 sec	18.0 sec	21.0 sec	23.0 sec
Jet Range	2 mt.	2 mt.	4 mt.	4 mt.	8 mt.
Height without base	325 mm	390 mm	500 mm	530 mm	600 mm
Diameter (Approx)	86 ± 10 mm	108 mm	140 mm	150 mm	180 mm
Filled weight (Approx)	2 Kg.	3.4 Kg.	6.7 Kg.	9 Kg.	13.18 Kg.
Empty weight (Approx)	1 Kg.	1.4 Kg.	2.7 Kg.	3 Kg.	4.18 Kg.
Operating temperature	-30°C to 55°C				
Working Pressure at 20° C	15 bar	15 bar	15 bar	15 bar	15 bar
Maximum Service Pressure	17 bar	17 bar	17 bar	17 bar	17 bar
Test Pressure	35 bar	35 bar	35 bar	35 bar	35 bar
Approval	BIS	BIS	BIS	BIS	BIS

## Carbon Dioxide Fire Extinguisher for "B" & "C" class of Fire

Suitable For All Flammable Liquids, Gases, Live & Delicate, Machinery Fires, Electrical & Sophisticated Electronic Equipments Fires Transformer & Switch Gear Fire  
**Specification :** Carbon Dioxide Fire Extinguisher Is Made Of Seamless Manganese Steel..This Extinguisher Is Approved By Explosive Department, Govt. Of India, Nagpur



PERFORMANCE DATA			
MODEL	2	3	4.5
Capacity	2 Kg	3 Kg	4.5 Kg
Fire Rating	8B	13 B	21B
Average discharge time	12 sec	14 sec	14 sec
Height (Approx.)	425 mm	470 mm	610 mm
Diameter (Approx)	108 mm ± 10 mm	140 mm ± 10 mm	140 mm ± 10 mm
Filled weight (Approx.)	8.9 kg or 8.2 Kg	12.5 kg or 11.8 kg	17 kg or 16.3 kg
Empty weight (Approx)	6.9 kg or 6.2 kg	9.5 kg or 8.8 kg	12.5 kg or 11.8 kg
Operating temperature	-30°C to +55°C	-30°C to +55°C	-30°C to +55°C
Working Pressure at 20° C	150 bar	150 bar	150 bar
Maximum Test Pressure	250 bar	250 bar	250 bar
APPROVAL	BIS	BIS	BIS

## Mechanical Foam Type Fire Extinguisher

Suitable for 'A & B' Class Fire Papers, Wood, Paints, Gases, Chemicals, Petroleum Product.



IS Specification : IS 15683 : 2006

Capacity : 9 Ltr.

Construction : Manufactured out E.D.D. Quality Seamless Bottom Welded

Charge : Foam Compound

Anti corrosive Treatment : Internally - Lead Tin Coating by electrolytic process. Externally - Lead Tin Coating with Fire Red Paint.

Accessories : Wall mounting brackets.

Operation : Pull out Safety Pin, Detach hose from the bracket and aim at the base of fire while Holding.

Maintenance : The Fire Extinguisher must be maintained as per IS : 2190 For satisfactory performance.

: Easy to use.

PERFORMANCE DATA	
MODEL	9
Capacity	9L
Fire Rating	4A : 34B
Average discharge time	50 sec
Height (Approx.)	575 mm
Diameter (Approx)	180 mm ± 10 mm
Filled weight (Approx.)	12.5 Kg.
Empty weight (Approx)	3.8 Kg
Operating temperature	+5°C to +55°C
Working Pressure at 20° C	15 bar
Maximum Service Pressure	17 bar
Test Pressure	35 bar
Approval	BIS

## Water Type Fire Extinguisher

Suitable for 'A' Class Fire Papers, Textile, Cloth, Wood.



IS Specification : IS 15683 : 2006

Capacity : 9 Ltr.

Construction : Manufactured out E.D.D. Quality Seamless Bottom Welded

Charge : Water

Anti corrosive Treatment : Internally - Lead Tin Coating by electrolytic process. Externally - Lead Tin Coating with Fire Red Paint.

Accessories : Wall mounting brackets.

Operation : Pull out Safety Pin, Detach hose from the bracket and aim at the base of fire while Holding.

Maintenance : The Fire Extinguisher must be maintained as per IS : 2190 For satisfactory performance.

: Easy to use.

PERFORMANCE DATA	
MODEL	9
Capacity	9L
Fire Rating	3A
Average discharge time	42 sec
Height (Approx.)	575 mm
Diameter (Approx)	180 ± 10 mm
Filled weight (Approx.)	12.5Kg.
Empty weight (Approx)	3.7Kg
Operating temperature	+5°C to +55°C
Working Pressure at 20° C	15 bar
Maximum Service Pressure	17 bar
Test Pressure	35 bar
Approval	BIS





## Dry Chemical Powder A.B.C. Type Fire Extinguisher (Stored pressure type)

Suitable for Class 'A', 'B' and 'C' Fires involving Wood, Paper, Burning Liquids, Oil Petrol, Paints Electricity and Gases Etc.



PERFORMANCE DATA					
MODEL	1	2	4	6	9
Capacity	1 Kg	2 Kg	4 Kg	6 Kg	9 Kg
Fire Rating	1A:8B	1A:13B	2A:21B	2A:34B	3A:55B
Average discharge time	9.0 sec	14.0 sec	18.0 sec	21.0 sec	23.0 sec
Jet Range	2 mt.	2 mt.	4 mt.	4 mt.	8 mt.
Height without base	325 mm	390 mm	500 mm	530 mm	600 mm
Diameter (Approx)	86 ± 10 mm	108 mm	140 mm	150 mm	180 mm
Filled weight (Approx)	2 Kg.	3.4 Kg.	6.7 Kg.	9 Kg.	13.18 Kg.
Empty weight (Approx)	1 Kg.	1.4 Kg.	2.7 Kg.	3 Kg.	4.18 Kg.
Operating temperature	-30°C to 55°C				
Working Pressure at 20° C	15 bar	15 bar	15 bar	15 bar	15 bar
Maximum Service Pressure	17 bar	17 bar	17 bar	17 bar	17 bar
Test Pressure	35 bar	35 bar	35 bar	35 bar	35 bar
Approval	BIS	BIS	BIS	BIS	BIS

## Carbon Dioxide Fire Extinguisher for "B" & "C" class of Fire

Suitable For All Flammable Liquids, Gases, Live & Delicate, Machinery Fires, Electrical & Sophisticated Electronic Equipments Fires Transformer & Switch Gear Fire  
**Specification :** Carbon Dioxide Fire Extinguisher Is Made Of Seamless Manganese Steel..This Extinguisher Is Approved By Explosive Department, Govt. Of India, Nagpur



PERFORMANCE DATA			
MODEL	2	3	4.5
Capacity	2 Kg	3 Kg	4.5 Kg
Fire Rating	8B	13 B	21B
Average discharge time	12 sec	14 sec	14 sec
Height (Approx.)	425 mm	470 mm	610 mm
Diameter (Approx)	108 mm ± 10 mm	140 mm ± 10 mm	140 mm ± 10 mm
Filled weight (Approx.)	8.9 kg or 8.2 Kg	12.5 kg or 11.8 kg	17 kg or 16.3 kg
Empty weight (Approx)	6.9 kg or 6.2 kg	9.5 kg or 8.8 kg	12.5 kg or 11.8 kg
Operating temperature	-30°C to + 55°C	-30°C to + 55°C	-30°C to + 55°C
Working Pressure at 20° C	150 bar	150 bar	150 bar
Maximum Test Pressure	250 bar	250 bar	250 bar
APPROVAL	BIS	BIS	BIS

## Mechanical Foam Type Fire Extinguisher

Suitable for 'A & B' Class Fire Papers, Wood, Paints, Gases, Chemicals, Petroleum Product.



IS Specification : IS 15683 : 2006

- Capacity : 9 Ltr.
- Construction : Manufactured out E.D.D. Quality Seamless Bottom Welded
- Charge : Foam Compound
- Anti corrosive Treatment : Internally - Lead Tin Coating by electrolytic process. Externally - Lead Tin Coating with Fire Red Paint.
- Accessories : Wall mounting brackets.
- Operation : Pull out Safety Pin, Detach hose from the bracket and aim at the base of fire while Holding.
- Maintenance : The Fire Extinguisher must be maintained as per IS : 2190 For satisfactory performance.

: Easy to use.

PERFORMANCE DATA	
MODEL	9
Capacity	9L
Fire Rating	4A : 34B
Average discharge time	50 sec
Height (Approx.)	575 mm
Diameter (Approx)	180 mm ± 10 mm
Filled weight (Approx.)	12.5 Kg.
Empty weight (Approx)	3.8 Kg
Operating temperature	+5°C to + 55°C
Working Pressure at 20° C	15 bar
Maximum Service Pressure	17 bar
Test Pressure	35 bar
Approval	BIS

## Water Type Fire Extinguisher

Suitable for 'A' Class Fire Papers, Textile, Cloth, Wood.



IS Specification : IS 15683 : 2006

- Capacity : 9 Ltr.
- Construction : Manufactured out E.D.D. Quality Seamless Bottom Welded
- Charge : Water
- Anti corrosive Treatment : Internally - Lead Tin Coating by electrolytic process. Externally - Lead Tin Coating with Fire Red Paint.
- Accessories : Wall mounting brackets.
- Operation : Pull out Safety Pin, Detach hose from the bracket and aim at the base of fire while Holding.
- Maintenance : The Fire Extinguisher must be maintained as per IS : 2190 For satisfactory performance.

: Easy to use.

PERFORMANCE DATA	
MODEL	9
Capacity	9L
Fire Rating	3A
Average discharge time	42 sec
Height (Approx.)	575 mm
Diameter (Approx)	180 ± 10 mm
Filled weight (Approx.)	12.5Kg.
Empty weight (Approx)	3.7Kg
Operating temperature	+5°C to + 55°C
Working Pressure at 20° C	15 bar
Maximum Service Pressure	17 bar
Test Pressure	35 bar
Approval	BIS



**HYDRANT ACCESSORIES**

**HYDRANT VALVE**




**DOUBLE HYDRANT VALVE**



**RRL CANVAS HOSE**



**MONITOR**



**FIRE SPRINKLER / DETECTION SYSTEM**

**FLEXIBLE ROPE**




**FIRE ALARM SYSTEM**




**SPRINKLER**



**FIRE SPRINKLER & HYDRANT SYSTEM**

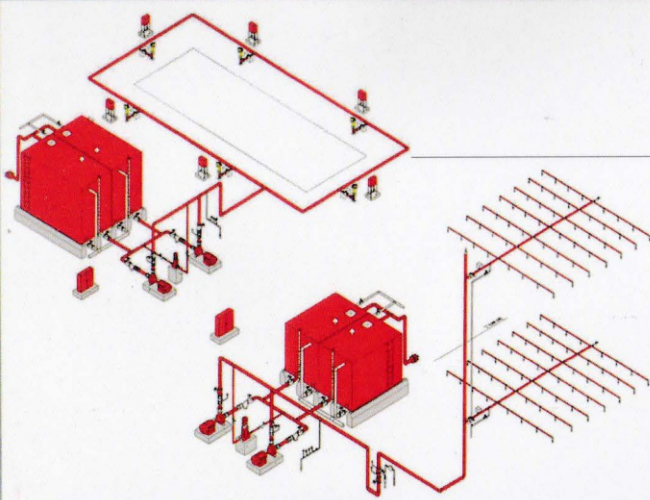

**FIRE SUPPRESSION SYSTEM**

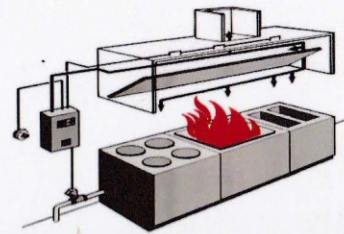

**ALARM VALVE**



**SPECIALLY FOR KITCHEN FIRE**



**K TYPE FIRE EXTINGUISHER**












**SIGN AGES FIRE (FIRE SAFETY STICKERS)**



**G-FORCE**<sup>TM</sup>  
FIRE SERVICES

Mob.: 9821886364 / 7506722506  
E-mail : mumbaigforce@gmail.com  
Website : www.gforcefire.in









**Govt. of Maharashtra**  
**Directorate of Maharashtra Fire Service**  
Vidyanagri, Hans Bhugra Marg, Santacruz (East),  
Mumbai – 400 098, Tel-022-26677555, Fax-022-26677666  
www.mahafireservice.gov.in

**FORM N**  
**[ ( See section 9 (3) and rule 14 ]**  
**License to act as a License Agency for the purpose of**  
**Fire Prevention and Life Safety Measure**

License No. MFS / LA / RF-51 / RD-52

Date: 29.01.2022

License is hereby renewed under the provisions of sub-section (3) of section 9 of the Maharashtra Fire Prevention and Life Safety Measure Act, 2006 (Mah. III of 2007) to **M/s. G-Force Fire Services** having their registration office at **E-11, Shree Ganesh CHS Ltd., Road No. 08, Gautam Nagar, Andheri (E), Mumbai 400093** and their contact details are Office Number: 9821886364 and Email ID: [mumbaigforce@gmail.com](mailto:mumbaigforce@gmail.com) with PAN registration No. ALSPS5753R and GST No. 27ALSPS5753R2ZQ to act as a License Agency for the purpose of the said Act for execution of the fire prevention and life safety measures in relation to

- 1. Fire Fighting and Sprinkler System:** Class D
- 2. Detection and Fire Suppression System:** Class D

**M/s. G-Force Fire Services** shall not issue Form A or Form B under sub-section (3) of section 3 regarding the compliance of the fire prevention and life safety measures or maintenance thereof in good repair and efficient condition, without there being actual such compliance or maintenance failing which license granted / renewed shall be suspended or cancelled as per sub section (4) of section 9 and shall be liable for penalty under section 36 of the Act.

Subject to the provision of sub section (4) of section 9 of the said Act and rule 14 of the Maharashtra Fire Prevention and Life Safety Measures Rules, 2009, the license will be valid for a period from **29.01.2022 to 28.01.2023**

Hatyal  
Kiran  
Asst Director

Digitally signed  
by Hatyal Kiran  
Date: 2022.02.04  
18:56:55 +05'30'

SHAMRAO  
HARIBA  
SHINDE

Digitally signed by  
SHAMRAO HARIBA  
SHINDE  
Date: 2022.01.31  
14:30:51 +05'30'

SANTOSH  
SHRIDHAR  
WARICK

Digitally signed by  
SANTOSH SHRIDHAR  
WARICK  
Date: 2022.02.04  
23:08:25 +05'30'

( **S S Warick** )  
Director  
Maharashtra Fire Service


Digital Signature of Authorized Person to sign Form A or Form B

Note:

\* in lieu of digital sign of license holder (responsible to issue Form A or Form B) the license will be treated as invalid.



# OUR VALUABLE CLIENTS









# Certificate of Registration

This is to Certify that  
Quality Management System of

## G-FORCE FIRE SERVICES

E/11 SHREE GANESH CHS. GAUTAM NAGAR, BEHIND AKRUTI CENTER POINT,  
M.I.D. C. ANDHERI (E), MUMBAI - 400093, MAHARASHTRA, INDIA.

has been assessed and found to conform to the requirements of  
**ISO 9001:2015**  
for the following scope :

SUPPLY OF FIRE FIGHTING / EQUIPMENTS AND APPROVED BY GOVERNMENT OF  
MAHARASHTRA LICENCE AGENCY.

Certificate No	: 21EQFN38	Issuance Date	: 10/01/2022
Initial Registration Date	: 10/01/2022		
Date of Expiry	: 09/01/2025		
1st Surve. Due	: 10/12/2022	2nd Surve. Due	: 10/12/2023



*Devendra*  
Director

**Magnitude Management Services Pvt. Ltd**

B-55, Lower Ground Floor, Sector 02, Noida-201301, U.P, India

e-mail: [info@mmscertification.com](mailto:info@mmscertification.com), website: [www.mmscertification.com](http://www.mmscertification.com)

\* Subject to Successful Surveillance Audit in case surveillance audit is not allowed to be conducted, this certificate shall be suspended/withdrawal).

Certificate Verification: Please Re-check the validity of certificate at <http://www.mmscertification.com/clients.aspx> or [www.mmscertification.com](http://www.mmscertification.com) at Active Clients.  
Certificate is the property of Magnitude Management Services Pvt. Ltd. and shall be returned immediately when demanded





## Dealership Certificate

**RAUNAK ENGINEERING WORKS** is pleased to appoint

M/s. GI-FORCE FIRE SERVICES

ADD:- E/11 SHREE GANESH CHS. GAUTAM NAGAR BEHIND AKRUTI CENTER POINT, MIDC ANDHERI (E) MUM- 400093.

as **Authorised Distributor / Dealer** for

PORTABLE FIRE EXTINGUISHER.

for the Period 1<sup>st</sup> JAN To 31<sup>st</sup> Dec 2022.

### RAUNAK ENGINEERING WORKS

**AN ISO 9001:2015 Certified Company**

H. O.: 17, Crescent Industrial Premises  
Co-op. Society Ltd., R. C. Loyalka Street,  
Khairani Road, Sakinaka,

Mumbai - 400 072. Maharashtra, India

TEL : +91-22-2851 7220

E-mail : raunakengineering@yahoo.co.in



**Authorised Signatory**